

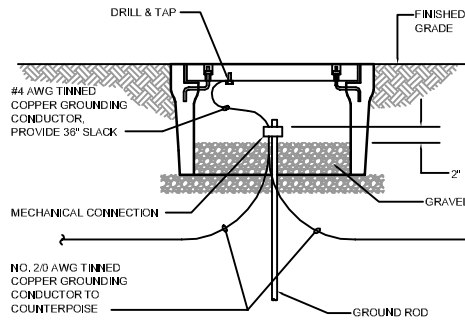
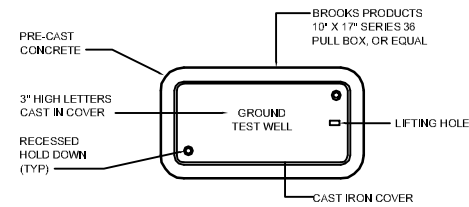


- NOTES:
1. DETAIL IS GENERIC. SPECIFIC LOCATIONS OF EQUIPMENT MAY VARY.
 2. TIE TO FENCE, MINIMUM 2 LOCATIONS, NOT REQUIRED WHERE PVC COATED, BLOCK, OR WOOD FENCE IS INSTALLED.
 3. PROVIDE EXOTHERMIC WELDS UNLESS NOTED OTHERWISE.


PUMP STATION GROUNDING
(TYPICAL)

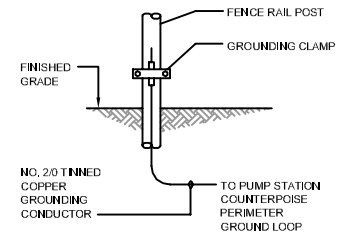

GROUND TEST WELL

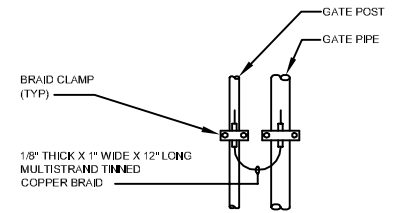

FENCE POST GROUNDING - IF APPLICABLE
(TYPICAL)

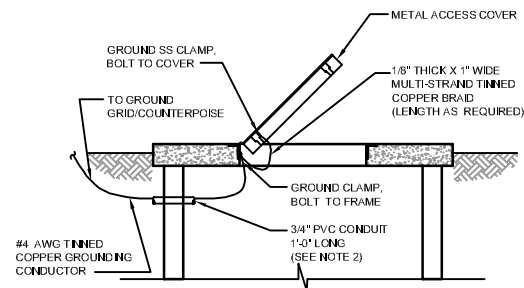

COVER AND DOOR GROUNDING

- NOTES:
1. ON COVERS WITH MULTIPLE DOORS, PROVIDE BRAID FROM FRAME TO DOOR ON EACH DOOR PROVIDE WATERPROOF CAULKING WHERE GROUND CABLE AND CONDUIT PENETRATES WELL TO PREVENT INTRUSION OF GROUNDWATER AND ESCAPE OF VAPORS FROM WELL.
 2. INSTALL GROUND WIRE SO THAT IT WILL NOT CROSS CLEAR OPENING OR PREVENT OR IMPEDE NORMAL METHOD OF REMOVING FLOATS OR PUMPS.

PUMP STATION GROUNDING DETAIL